LBNL-5251E

ERNEST ORLANDO LAWRENCE
BERKELEY NATIONAL LABORATORY

# Optimal Planning and Operation of Smart Grids with Electric Vehicle Interconnection

**Michael Stadler, Chris Marnay, Maximilian Kloess, Gonçalo Cardoso, Gonçalo Mendes, Afzal Siddiqui, Ratnesh Sharma, Olivier Mégel, and Judy Lai**

**Environmental Energy Technologies Division**

**January 2, 2012**

**to be published in the Journal of Energy Engineering, American Society of Civil Engineers (ASCE), Special Issue: Challenges and opportunities in the 21st century energy infrastructure, ISSN 0733-9402 / e-ISSN - 1943-7897**

***http://eetd.lbl.gov/EA/EMP/emp-pubs.html***

The work described in this paper was funded by the Office of Electricity Delivery and Energy Reliability, Distributed Energy Program of the U.S. Department of Energy under Contract No. DE-AC02-05CH11231 and by NEC Laboratories America Inc. We also want to thank Professor Dr. Tomás Gómez and Ilan Momber for their very valuable contributions to previous versions of DER-CAM.

**Disclaimer**

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.

Ernest Orlando Lawrence Berkeley National Laboratory is an equal opportunity employer.

# Optimal Planning and Operation of Smart Grids with Electric Vehicle Interconnection

M. Stadler[1], C. Marnay[2], M. Kloess[3], G. Cardoso[4], G. Mendes[5], A. Siddiqui[6], R. Sharma[7], O. Mégel[8], J. Lai[9]

**Abstract**
Connection of electric storage technologies to smartgrids will have substantial implications for building energy systems. Local storage will enable demand response. When connected to buildings, mobile storage devices such as electric vehicles (EVs) are in competition with conventional stationary sources at the building. EVs can change the financial as well as environmental attractiveness of on-site generation (e.g. PV or fuel cells). In order to examine the impact of EVs on building energy costs and $CO_2$ emissions, a distributed-energy-resources adoption problem is formulated as a mixed-integer linear program with minimization of annual building energy costs or $CO_2$ emissions and solved for 2020 technology assumptions. The mixed-integer linear program is applied to a set of 139 different commercial buildings in California and example results as well as the aggregated economic and environmental benefits are reported. Special constraints for the available PV, solar thermal, and EV parking lots at the commercial buildings are considered. The research shows that EV batteries can be used to reduce utility-related energy costs at the smart grid or commercial building due to arbitrage of energy between buildings with different tariffs. However, putting more emphasis on $CO_2$ emissions makes stationary storage more attractive and stationary storage capacities increase while the attractiveness of EVs decreases. The limited availability of EVs at the commercial building decreases the attractiveness of EVs and if PV is chosen by the optimization, then it is mostly used to charge the stationary storage at the commercial building and not the EVs connected to the building.

**Keywords**
carbon emissions, combined heat and power, commercial buildings, distributed energy resources, distributed generation, electric vehicle, load shifting, microgrid, optimization, smart grid, storage technologies

## 1. Introduction

Several papers analyze the impact of renewable energy sources and EVs on the power grid and electricity prices. For example, Sioshansi and Denholm, 2009 look into the possibility of providing ancillary services and storage capabilities to the power grid by utilizing plug-in hybrid electric vehicles (PHEVs). Wang et al., 2010 model the impact on electricity prices due to additional power grid loads from EVs. Since buildings are the link between the power system and the EVs, this work uses a building centric approach and looks into the cost and $CO_2$ benefits for buildings adopting distributed energy resources (DER). Furthermore, there are many DERs in a building which will be influenced by EV batteries. Also, stationary storage in buildings attracts more research attention and this can create competition between mobile storage and stationary storage. On the other hand, when mobile storage is not suitable for EV usage anymore it can be recycled and used as stationary storage in buildings, where the battery specifications can be relaxed. This 2$^{nd}$ life of EV batteries attracts the attention of researchers and this might also create opportunities for EV batteries (see also TSRC). All these options and interactions of DER in buildings require an integrated approach for analyzing the benefits of EVs connected to buildings.

This paper focuses on the analysis of the optimal interaction of electric vehicles (EVs) with commercial smartgrids/microgrids, which may include photovoltaic (PV), solar thermal, stationary batteries, thermal storage, and combined heat and power (CHP) systems with and without absorption chillers. A microgrid is a group of interconnected loads and DER within clearly defined electrical boundaries that acts as a single controllable entity with respect to the grid. A microgrid can connect and disconnect

[1] Ernest Orlando Lawrence Berkeley National Laboratory, One Cyclotron Road, MS: 90-1121, Berkeley, California 94720, USA and Center for Energy and Innovative Technologies, Austria, MStadler@lbl.gov
[2] Ernest Orlando Lawrence Berkeley National Laboratory, USA, ChrisMarnay@lbl.gov
[3] Ernest Orlando Lawrence Berkeley National Laboratory, USA and Vienna University of Technology, Austria, Kloess@eeg.tuwien.ac.at
[4] Instituto Superior Técnico - MIT Portugal Program, Portugal, Goncalo.cardoso@ist.utl.pt,
[5] Instituto Superior Técnico - MIT Portugal Program, Portugal, Goncalo.P.Mendes@ist.utl.pt
[6] University College London, UK and Stockholm University, Sweden, Afzal@stats.ac.ucl.uk
[7] NEC Laboratories America Inc., USA, Ratnesh@sv.nec-labs.com
[8] Ecole Polytechnique Fédérale de Lausanne, Switzerland, Olivier.Megel@epfl.ch
[9] Ernest Orlando Lawrence Berkeley National Laboratory, USA, JLai@lbl.gov

from the grid to enable it to operate in both grid-connected or island mode. An overview of microgrids can be found in Hatziargyriou et al., 2007.
In previous work, Berkeley Lab has developed the Distributed Energy Resources Customer Adoption Model (DER-CAM) with its mathematical formulation documented in Siddiqui et al., 2005 and Stadler et al., 2008. Its optimization techniques find both the combination of equipment and its operation over a typical year that minimizes the site's total energy bill or carbon dioxide ($CO_2$) emissions, typically for electricity plus natural gas purchases, as well as amortized equipment purchases. It outputs the optimal distributed generation (DG) and storage adoption combination and an hourly operating schedule, as well as the resulting costs, fuel consumption, and $CO_2$ emissions. DER-CAM always takes the perspective of the building owner or operator since it is a customer adoption model and does not optimize the benefits of utilities or the society directly. However, the results can be aggregated to a state level as shown below, which allows estimating changes in the state's or the commercial sector's $CO_2$ emissions.

Berkeley Lab has access to the California End-Use Survey (CEUS), which holds roughly 2700 building load profiles for the commercial sector in California (see CEUS). These hourly load profiles are needed to make optimal decisions on the operation of the DG equipment, which influences the optimal DG investment capacities since DER-CAM considers amortized investment and operation costs. Berkeley Lab compiled a database of 139 representative building load profiles for buildings with peak loads between 100 kW and 5 MW, and buildings in this size range account for roughly 35% of total statewide commercial sector electric sales (Stadler et al., 2009). The 139 load profiles are made up of the following building types in different sizes: hospitals, colleges, schools, restaurants, warehouses, retail stores, groceries, offices, and hotels/motels.

Mobile storage can directly contribute to tariff-driven demand response in these commercial buildings. By using EVs connected to the buildings for energy management, the buildings could arbitrage their costs. However, since the car battery lifetime is reduced due to the increased energy transfer, a model that also reimburses car owners for the degradation is required. In general, the link between a microgrid and an EV can create a win-win situation, wherein the microgrid can reduce utility costs by load shifting, while the EV owner receives revenue that partially offsets his/her expensive mobile storage investment. Previous work done for certain types of buildings shows that the economic impact for the car owner is limited relative to the costs of mobile storage for the site analyzed, i.e., the economic benefits from EV connections are modest (Momber et al., 2010 and Mendes et al., 2011). However, that work does not consider all possible DER technologies in buildings nor does it track the $CO_2$ savings from mobile storage connected to buildings.

This paper will specifically focus on the new EV equations in DER-CAM, e.g. EV specific electric balance equation or $CO_2$ emissions from EV electricity exchange, and assess the impact of EVs connected to different types of commercial buildings in 2020. The 139 buildings are grouped in different climate zones in California and within the three major utility service territories of Pacific Gas & Electric (PG&E), Southern California Edison (SCE), and San Diego and Gas Electric (SDG&E). Please note that this paper does not model the impact on electricity prices due to additional power grid loads from EVs and the assumed tariffs for the three used service territories are assumed to be static. For impacts on marginal energy prices please refer to (Wang et al., 2010). Furthermore, this work uses an area constraint for the maximum possible PV and solar thermal adoption as well as for the available EV parking space. This constraint has a significant impact on the DER adoption and operation and can drive up building energy costs.

The structure of this paper is as follows:

- Section 2 describes the Distributed Energy Resources Customer Adoption Model (DER-CAM)
- Section 3 discusses how EVs are modeled in DER-CAM
- Section 4 presents the data used for the analyses performed here
- Section 5 provides the results and discusses the impact on mobile and stationary storage adoption
- Section 6 summarizes the paper, discusses its limitations, and provides directions for future research in this area.

## 2. DER-CAM

DER-CAM is a mixed-integer linear program (MILP) written and executed in the General Algebraic Modeling System (GAMS). Its objective is typically to minimize the annual costs or $CO_2$ emissions for providing energy services to the modeled site, including utility electricity and natural gas purchases, plus amortized capital and maintenance costs for any DG investments. Other objectives, such as carbon or energy minimization, or a combination are also possible. The approach is fully technology-neutral and can include energy purchases, on-site conversion, both electrical and thermal on-site renewable harvesting. Furthermore, this approach considers the simultaneity of results. For example, building cooling technologies are chosen such that the results reflect the benefit of electricity demand displacement by heat-activated cooling, which lowers building peak load and, therefore, the on-site generation requirement, and also has a disproportionate benefit on bills because

of demand charges and time-of-use (TOU) energy charges. Site-specific inputs to the model are end-use energy loads, detailed electricity and natural gas tariffs, and DG investment options. In general these load profiles can be simulated and gathered from building simulation tools (EnergyPlus) or taken from building information systems in the case of existing buildings.

Figure 1 shows a high-level schematic of the possible building energy flows modeled in DER-CAM. For this we use Sankey diagrams, which show in a graphical way how loads can be met by different resources at given efficiencies (Schmidt, 2006). Thus, a Sankey diagram provides a full view of possible resources that can be considered within the optimization.

Available energy inputs to the site are solar radiation, utility electricity, and utility natural gas. The location-specific solar radiation will impact the adoption of PV and solar thermal technologies. Previous work has shown that the utility electricity prices and utility natural gas prices are a main driver for natural gas fired distributed technologies. The gross margin of a gas-fired power plant from selling a unit of electricity (spark spread) determines the attractiveness of the plant. In case of TOU tariffs, the spark spread increases dramatically during the expensive (normally noon) hours, which increases the attractiveness of gas-fired technologies.

DER-CAM solves the mixed integer linear problem over a given time horizon, e.g., a year, and selects the economically or environmental optimal combination of utility electricity purchase, on-site generation, storage and cooling equipment required to meet the site's end-use loads at each time step. In other words, DER-CAM looks into the optimal combination/adoption and operation of technologies to supply the services specified on the right hand side of Figure 1. All the different arrows in Figure 1 represent energy flows, and DER-CAM optimizes these energy flows to minimize costs or $CO_2$ emissions. Black arrows represent natural gas or any bio-fuel, light grey represents electricity, and darker grey heat and waste heat, which can be stored and/or used to supply the heat loads or cooling loads via absorption cooling.

The outputs of DER-CAM include the optimal DG/storage adoption and an hourly operating schedule, as well as the resulting costs, fuel consumption, and $CO_2$ emissions. The approach does not consider EVs in isolation but rather alongside the rest of the DER equipment. All available technologies compete and collaborate, and simultaneous results are derived. In this way, it can be shown that PV and stationary electric storage can compete in certain situations. If the focus of the optimization is on cost minimization and a TOU rate with high costs during noon hours is used, then it can be demonstrated that stationary electric storage will be discharged at the same time when the PV system is operational (Stadler et al., 2009b). The on-site fuel use and carbon savings are, therefore, quite accurately estimated and can deviate significantly from simple estimates. Also, the optimal pattern of utility electricity purchase is accurately delivered. Finding likely solutions to this complex problem for multiple buildings would be impossible using simple analysis, e.g. using assumed equipment operating schedules and capacity factors. Because CEUS buildings each represent a certain segment of the commercial building sector, results from typical buildings can readily be scaled up to the state level in order to provide policymaking insights.

## 3. EV Approach

Once EVs are connected to commercial buildings, electricity from their batteries can be transferred to and from the sites. The building energy management system (EMS) can use this additional battery capacity to lower its energy bill and/or carbon footprint. Whenever possible, economically attractive energy from a renewable energy source or CHP system at the building could be used to offset EV charging at home. In this paper, DER-CAM is used to find the optimal charging and discharging schedule for the EV batteries. Decision variables are, therefore, the activity levels of all available energy sources so that energy loads are met, as well as the optimal installed capacity, making it a three-level assignment problem: energy loads, supply scheduling, and installed capacity. Included in these variables are utility energy purchases, local energy production, and EV interactions, which are the focus of this paper. It is assumed that the EV owner will receive compensation for battery degradation caused by the commercial building EMS and is reimbursed for the amount of electricity charged at home and later fed into the commercial building (see equations 1 & 5). On the other hand, if the EV is charged by electricity originating from the commercial building, then the car owner needs to pay the commercial building for the electricity.

$$C_{bat} = E_{EV} * CL * RC_{bat} \quad (1)$$

| | |
|---|---|
| $C_{bat}$ | EV battery degradation annual costs caused by the commercial building, $ |
| $E_{EV}$ | total annual electricity exchange through the EV battery, caused by the commercial building, kWh |
| CL | capacity loss factor, dimensionless |
| $RC_{bat}$ | replacement cost of the EV battery, $/kWh |

The monetary losses attributable to charging and discharging as well as the decay will be covered by the commercial building. However, since this work also reports on the environmental impact of EVs connected to commercial buildings, the modeling of the marginal $CO_2$ emissions is important. The marginal $CO_2$ emissions when the EVs are plugged in at residential buildings for charging are tracked as this is necessary to be able to calculate the proper $CO_2$ changes in the commercial buildings (see equations 6 & 7). Consider the abstract state of charge (SOC) pattern (solid black line) for an EV connected to an office building in Figure 2, and it is obvious that the commercial building benefits from energy (area A) that has a carbon foot print that is related to times when the EV is not connected to the commercial building. Since the state of charge at disconnection ($SOC_{out}$) is less than at connection ($SOC_{in}$), a net energy transfer to the commercial building takes place and that energy might have a different carbon content since it originates from other sources at different times. Therefore, tracking the $CO_2$ emissions and different cases is an important feature within DER-CAM. This becomes even more complicated if the EVs are connected to different buildings during a certain period of time[10].

The high-level formulation used in DER-CAM follows the standard linear programming approach:

$$\begin{aligned} &\text{Min } f = c^T x \qquad (2)\\ &\text{s.t.}\\ &Ax \leq b\\ &L \leq x \leq U \end{aligned}$$

where:

| | |
|---|---|
| c | cost coefficient vector |
| x | decision variable vector |
| A | constraint coefficient matrix |
| b | constraint coefficient vector |
| L | decision variable lower boundary vector |
| U | decision variable upper boundary vector |

This translates to DER-CAM in the simplified[11] mathematical formulation explained below, where an emphasis is given to EV specific formulation. Please refer to Figure 3 for the representative MILP solved by DER-CAM

### *3.1 Input Parameters*

#### *a. Indices*

| | |
|---|---|
| $m$ | month index (1,2,… 12) |
| $h$ | hour index (1,2,… 24) |

#### *b. Market data*

| | |
|---|---|
| $C_{fix\ m}$ | fixed electricity costs, $ |
| $CO_{2\ EV\text{-}home\ m,h}$ | macrogrid $CO_2$ emission during home charging period, $kgCO_2/kWh$. These are the $CO_2$ emissions of energy transferred to the commercial building. $CO_{2EV\text{-}home\ m,h}$ is calculated based on the emissions when the EV is connected to the residential building. |

#### *c. EV parameters*

| | |
|---|---|
| $c$ | EV battery capacity, kWh |
| $\overline{cr}$ | EV battery maximum charge rate, dimensionless |
| $\overline{dr}$ | EV battery maximum discharge rate, dimensionless |
| $p_{EV}$ | EV electricity exchange price, $/kWh. Set to residential charging rate for EVs |
| $\overline{SOC}$ | EV battery maximum state of charge, dimensionless |
| $\underline{SOC}$ | EV battery minimum state of charge, dimensionless |
| $\eta_c$ | EV battery charging efficiency, dimensionless |
| $\eta_{dc}$ | EV battery discharging efficiency, dimensionless |
| $\varphi$ | electricity storage loss factor for the EV battery, dimensionless |

[10] Multiple building connections are not considered in this work.

[11] The full DER-CAM code consists of roughly 5600 lines of code for equations, parameters, and data sets. Please note that the full detailed mathematical formulation of DER-CAM is roughly 17 pages.

*d. Customer loads*

$D_{B\ m,h}$ electricity demand from the building, kWh

### 3.2 Decision Variables

*a. Costs*

$C_{total}$ total annual energy cost of the commercial building, $
$C_{elec}$ electricity costs, $
$C_{DER}$ distributed energy resources costs (amortized capital costs of investments), $.
$C_{fuel}$ fuel costs, $
$C_{DR}$ demand response costs for other non-storage technologies, $
$C_{bat}$ EV battery degradation costs, $
$C_{var\ m,h}$ variable electricity costs (energy and demand charges), $
$C_{EV\ m,h}$ EV electricity costs, $

*b. $CO_2$ emissions*

$CO_{2_total}$ total annual $CO_2$ emissions, $kgCO_2$
$CO_{2_elec}$ $CO_2$ emissions from electricity consumption, $kgCO_2$
$CO_{2_fuel}$ $CO_2$ emissions from DG fuel burning, $kgCO_2$
$CO_{2_EV}$ $CO_2$ emissions from EV electricity exchange, $kgCO_2$

*c. Electricity exchange with the micorgrid/building*

$S_{U\ m,h}$ electricity supplied by the utility, kWh
$S_{DER\ m,h}$ electricity supplied by distributed energy resources, kWh
$S_{St\ m,h}$ electricity supplied by local/stationary storage, kWh
$V_{m,h}$ electricity sales, $

*d. Electricity exchange with EVs*

$D_{EV\ m,h}$ electricity demand from EVs, kWh
$D_{St\ m,h}$ electricity demand from local/stationary storage, kWh
$E^{c\to r}_{m,h}$ electricity flow from car to residential building, $E^{c\to r} \leq 0$, kWh
$E^{r\to c}_{m,h}$ electricity flow from residential building to car, kWh
$ES_{EV\ m,h}$ electricity stored in EVs, kWh
$i_{m,h}$ EV storage input, kWh
$o_{m,h}$ EV storage output, kWh
$S_{EV\ m,h}$ electricity supplied by EVs, kWh

### 3.3 Objective Function – cost minimization

The most commonly used goal function in DER-CAM is total energy cost minimization. This includes electricity related costs, amortized capital costs of DER equipment, fuel costs, demand response measure costs, EV battery degradation costs, and sales.

$$\min C_{total} = C_{elec} + C_{DER} + C_{fuel} + C_{DR} + C_{bat} - \sum_m \sum_h V_{m,h} \quad (3)$$ [12]

$$C_{elec} = \sum_m \sum_h \left(C_{fix\ m} + C_{var\ m,h} + C_{EV\ m,h}\right) \quad (4)$$

$$C_{EV\ m,h} = p_{EV} * \left(\frac{E^{r\to c}_{m,h}}{\eta_c} + E^{c\to r}_{m,h} * \eta_{dc}\right) \quad (5)$$

### 3.4 Objective Function – $CO_2$ minimization

As mentioned previously, a second objective function is also available to DER-CAM. In this case, the objective becomes minimizing total $CO_2$ emissions, which includes emissions linked to utility electricity and fuel usage, but also to the $CO_2$ emissions associated with the use of electricity from EVs and their charging at different time periods.

$$\min CO_{2\ total} = CO_{2\ elec} + CO_{2\ fuel} + CO_{2\ EV} \quad (6)$$ [13]

[12] Please note that only the EV relevant variables of equation 3 are shown in more detail. For $C_{bat}$ please refer to equation 1.
[13] Please note that only the EV relevant variables of equation 6 are shown in more detail.

$$CO_{2\,EV} = \sum_m \sum_h \left( \left( \frac{E^{r\to c}{}_{m,h}}{\eta_c} + E^{c\to r}{}_{m,h} * \eta_{dc} \right) * CO_{2_{EV-home_{m,h}}} \right) \quad (7)$$

### 3.5 *Constraints*

*a. Balance equations*

This includes electric, heating and cooling balance equations, but we focus on the electric balance (equation 8), as this relates to the EV interactions. Another relevant example is the EV battery specific electric balance equation (equation 9).

$$S_{U\,m,h} + S_{DER\,m,h} + S_{St\,m,h} + S_{EV\,m,h} + V_{m,h} = D_{B\,m,h} + D_{St\,m,h} + D_{EV\,m,h} \quad (8)$$

$$ES_{EV\,m,h} = ES_{EV\,m,h-1} * (1-\varphi) + i_{m,h} - o_{m,h} \quad (9)$$

*b. Operational constraints*

Operational constraints are applied to all technologies involved in DER-CAM, and are used, for instance to model technology behavior. Highlighted here are the net input and output electric flows from EVs (equations 10 &11), as well as capacity related constraints (equations 12, 13 &14).

$$S_{EV\,m,h} = o_{m,h} * \eta_{dc} \quad (10)$$

$$D_{EV\,m,h} = \frac{i_{m,h}}{\eta_c} \quad (11)$$

$$c * \underline{soc} \le ES_{EV\,m,h} \le c * \overline{soc} \quad (12)$$

$$i_{m,h} \le c * \overline{cr} \quad (13)$$

$$o_{m,h} \le c * \overline{dr} \quad (14)$$

## 4. Input Data, Technology Specification, and Parameters

The starting point for the hourly load profiles used within DER-CAM is the CEUS database, which contains 2790 premises in total. DER are very common at industrial buildings with electric peak loads above 5 MW, but mostly overlooked for commercial buildings with loads below 5 MW. Thus, the focus here is on mid-sized buildings, between 100 kW and 5 MW electric peak load, and the assumption that DER will not be attractive for <100 kW buildings. This assumption results in the consideration of 35% of the total commercial electric demand in the service territories of PG&E, SCE, and SDG&E.

As is typical for Californian utilities, the electricity tariff has a fixed charge plus TOU pricing for both energy and power (demand) charges. The latter are proportional to the maximum rate of consumption (kW), regardless of the duration or frequency of such consumption over the billing period. Demand charges are assessed monthly and may be for all hours of the month or assessed only during certain periods, e.g. on-, mid-, or off-peak, or be assessed at the highest monthly hour of peak system-wide consumption. For example, for buildings with electric peak loads above 500 kW in PG&E's service territory, the E-19 TOU tariff is used as the 2020 estimate. This tariff is used for the PG&E school example in the next section. The E-19 consists of a seasonal demand charge between $13.51/kW (summer) and $1.04/kW (winter), the TOU tariff varies between $0.16/kWh (on-peak) and $0.09/kWh (off-peak) in the summer months (May-Oct). Winter months show only $0.01/kWh difference between mid-peak and off-peak hours. Summer on-peak is defined from 12:00-18:00 on weekdays. All details of E-19 can be found at (PG&E E-19 tariff). It is assumed that in PG&E and SCE service territory the EVs can be charged at home at night for 6c/kWh (PG&E E-9 tariff) and in the SDG&E for 14c/kWh. All used commercial utility tariffs for this paper can be found at (Stadler et al., 2009). The demand charge in $/kW/month as well as the on-peak energy costs are a significant determinant of technology choice and sizing of DG and electric storage system installations as can be seen in the next section.

As described in previous sections, DER-CAM finds the optimal combination of technologies in order to reach the objective, defined in the specific runs. The available investment options comprise of technologies for distributed generation of electricity, heating and cooling energy, as well as storage technologies. DER-CAM distinguishes between discrete and continuous technologies to improve the optimization speed of DER-CAM: the former can only be picked in discrete sizes, whereas the latter may be selected in any size. However, discrete technologies allow modeling of economies of scale in a better way than continuous ones, and therefore, some important technologies, e.g. CHP are considered as discrete ones. For discrete technologies please refer to Table 1 and for continuous ones to Table 2.

In DER-CAM, there are two types of internal combustion engines (ICE) and fuel cells (FC) available – with and without heat exchangers (HX) (see Table 1). HX can enable waste heat utilization for hot water usage and absorption cooling, thereby allowing total energy conversion efficiencies of up to 80%. Their technical specifications and costs are based on historic data and our own estimates (Goldstein et al., 2004, Firestone, 2004, and SGIP, 2008). The continuous technologies available in DER-CAM at this point are PV, solar thermal collectors, absorption chiller systems as well as thermal and electric storage, and EV batteries. Costs of continuous technologies available in 2020 are derived from various sources and are displayed in Table 2. For storage technologies, the economic performance and, hence, the adoption by the building EMS is also affected by some key technical parameters (see Table 3). First, there is the charging and discharging efficiency of the storage. For both electric and thermal storage, a charging and discharging efficiency of 90% is assumed, thus representing a technology status likely to become standard in 2020. Another important parameter is the decay of the storage systems, which defines their degradation due to usage. Finally, there is the maximum charging and discharging rate, which is a key input for the building energy management system, since it determines the maximum energy flow that the storage can provide to the building at every time step.

For the mobile storage systems, it is assumed that Li-Ion batteries with a capacity of 16 kWh are used. This is roughly the size of current EVs or plug-in hybrid vehicles and is used as a proxy for vehicle batteries connected to the commercial building (GreenCarCongress). For mobile storage systems, a charging/discharging efficiency of 95% is assumed, a value likely to be the standard in 2020, given the dynamic progress in this field. Battery decay is an important parameter for mobile storage as well, since it defines the degradation cost that has to be covered by the commercial building when using mobile storage capacities (see section "EV Approach"). Table 5 shows the assumed times when vehicles are connected to the different building types and can be used by the EMS in principle. This, of course, neglects the stochastic nature of the driving patterns. However, sensitivity results show that the main results for the charging and discharging strategies for mobile storage, derived from this deterministic work will basically hold under consideration of uncertain driving patterns. Driving patterns just changes the connection periods to the buildings, but not the main drivers for the charging cycles - the electricity prices. Finally, Table 6 shows the area constraint used for PV, solar thermal, and EV parking space. Based on the CEUS database, the average floor space was taken as an estimate for the maximum area available for these technologies. Since no detailed building information can be collected from CEUS, no other information is available.

The marginal carbon emissions of the macrogrid for 2020 are taken from Mahone et al. 2008.

## 5. DER-CAM Results

Results for cost minimization, $CO_2$ minimization, and multi-objective optimization for two selected buildings of the CEUS building stock are shown in this section. A large school in the San Francisco Bay Area with 3340 $m^2$ floorspace and 550kW electric peak load as well as a healthcare facility in San Diego with 3260 $m^2$ floorspace and 400kW electric peak load are selected. These two examples are used to demonstrate how mobile storage capacity is adopted in commercial buildings considering an area constraint for PV, solar thermal, and EV adoption, and how it interacts with buildings' DG output and stationary storage. At the end of this section, we show the aggregated results on $CO_2$ savings, number of EVs used, and capacity of PV, as well as other DG for the state of California, considering the building types and climate zones from CEUS.

DER-CAM allows optimization of the weighted building energy costs and $CO_2$ emissions at the same time by using a multi-objective approach (see equation 15). By increasing *w,* more focus on $CO_2$ emission reduction is placed, and this approach allows showing the trade-off between costs and $CO_2$ emissions[14] in a building.

$$\min\ (1-\omega) * \frac{C_{\text{total}}}{\text{RefCost}} + \omega * \frac{CO_{2\,\text{total}}}{\text{Ref}CO_2\text{Em}} \qquad (15)$$

where:

| | |
|---|---|
| $\omega$ | weight factor [0..1] |
| $\text{Ref}CO_2\text{Em}$ | parameter to make equation unit less |
| RefCost | parameter to make equation unit less |

By analyzing the cases of minimal costs ($\omega$=0) and four further cases with increasing $\omega$ (S1 to S4), we approximated the multi-objective frontier of the school building and the healthcare facility in two different parts of California. The principal connection periods of EVs to the commercial buildings differ for each building type and are shown in Table 5. In both the school and healthcare buildings, it is assumed that the EVs connect to the commercial buildings at 8 AM and disconnect at 6 PM. During that time, the building EMS can manage the mobile storage in combination with other DER technologies, and

[14] Please note that DER-CAM tracks the $CO_2$ emissions transferred to the commercial building by mobile storage.

different optimization strategies can apply. From 6 PM to 8 AM, the EVs are disconnected from the commercial buildings and are subject to driving and charging/discharging at the residential building. Both scenarios are subject to very different EV charging tariffs at the residential buildings. In the San Francisco Bay Area, EVs can be charged for 6cents/kWh compared to 14cents/kWh in San Diego. This difference in price will influence the overall level of EV adoption, but still, general insights can be derived from these two cases.

Figure 4 and 5 show that total energy costs can be reduced by using EVs in the building (see do-nothing vs. min cost in Figure 4 and 5), but more focus on $CO_2$ emission reduction results in fewer EVs connected to the building (mobile storage curve in Figure 4 and 5). Despite the major difference in electricity tariff rates, both cases show a similar pattern and show increasing stationary storage capacities combined with decreasing numbers of EVs connected to buildings. The space constraints impact the results dramatically as evidenced by the nearly vertical multi-objective frontier from S2 and S1 in Figures 4 and 5, respectively. The maximum area available for PV and solar thermal is 3340 $m^2$ for the large school building and 3260 $m^2$ for the healthcare facility. Also, the parking space for EVs is constrained by 3340$m^2$ and 3260 $m^2$ respectively. Another finding from the optimization runs shown in Table 7 and 8 is the importance of natural gas fired fuel cell systems with CHP. Due to the heat requirement and as well as the area constraint, efficient fuel cell systems, which allow total efficiencies up to 80%, will be used during times when solar thermal or PV cannot be selected. For more detailed results for all optimization cases, please refer to Tables 7 and 8.

The major *cost reduction* strategy derived from the DER-CAM optimization is to charge EVs with cheap electricity at home and provide that energy during connection times to the commercial building (Figure 6 and 9). The higher residential EV charging rates in San Diego, however, reduce the connected numbers of EV in Figure 5. Figures 6 to 8 show the optimal diurnal electric pattern for different optimization cases for the large school building in the San Francisco Bay Area. Figure 6 clearly shows that EVs will be used to minimize utility related energy and demand charges, since the mobile storage will be discharged during expensive mid- and on-peak hours (9 AM to 6 PM). No other DER technologies will be adopted at the school.

Figure 7 illustrates the electric pattern for the school building with a multi-objective function for point S2. In this case, considerable PV of 352 kW and stationary storage capacity of 2068 kWh is installed. The connected mobile storage is practically negligible (14 kWh, or one vehicle) and so is the transferred electricity. There is a significant difference between summer and winter days in the way how stationary batteries are used. In summer, they are charged in the afternoon with excessive PV power and discharged at the beginning of the evening before CHP is activated (see Figure 7). In winter, they are charged during night hours with excessive CHP capacity and discharged in the morning hours before sufficient PV power is available (see Figure 8). In this case, stationary storage plays an important role for the electricity supply of the building especially in winter days.

Figure 9 shows the electric pattern for the San Diego healthcare facility on a summer day with cost minimization (corresponding to the point min. cost, $w$=0 in Figure 5). In this case, the electricity for the building is mainly supplied by DG and by the utility. During peak hours, energy transfer from mobile storage is used to cover marginal demand. In the cost minimization case, there is no PV installed and no stationary battery capacity. One reason for this is the way capital costs of storage systems are considered within DER-CAM. Stationary storage is owned by the building, and therefore, the annualized capital costs for stationary storage will be considered in the optimization. In contrast, mobile storage is owned by the car owner, and therefore, no major capital cost reimbursements are assumed – the cars are simply around and utilized. However, this also means that stationary storage has considerable disadvantages in a pure cost minimization strategy.

Figure 10 depicts the S1 case from Figure 5. In this case, PV is used to cover large parts of the total demand during day hours, thereby replacing CHP generation and consumption from the utility. During peak hours, energy from EVs is used to cover some demand. In the afternoon, EVs are used to balance supply and demand when DG/CHP is activated, and they absorb excessive electricity. Later, when demand decreases and CHP is shut down again due to a must take from PV and a 50% minimum capacity[15] constraint on CHP, they feed electricity back to the building. Stationary batteries are charged in the morning and are discharged in late afternoon where they compensate the reduction in supply when EVs are leaving the building. Figure 10 also shows that waste heat utilization and absorption cooling reduces the electricity demand during expensive day hours and contributes to cost reductions (see cooling offset at the top of Figure 10).

[15] To limit non-linear effects, the adopted discrete technologies need to be shut down at a minimum capacity of 50% of the nameplate capacity.

With increasing priority to $CO_2$ reduction, as assumed in S2 (Figures 11 and 12), the full PV potential of the building is exploited. In summer, PV can cover almost the entire demand between 10 AM and 2 PM. Electricity from EVs is transferred to the building during shoulder hours (9-10 AM and 2-4 PM). In winter days, the total load of the building is considerably lower mainly because of lower cooling demand. This is why excessive supply from PV can be used to transfer electricity to the stationary storage around midday to be used in afternoon and evening hours. In the afternoon, PV is used to charge EVs (see Figure 12).

Summing up the results for the two buildings, analyzed in detail with respect to EVs, we have seen that the use of mobile storage capacity from EVs is driven by the objective of cost minimization rather than efficiency improvement (Figures 6 and 9). The availability of EV storage capacity to the building is also strongly dependent on the tariff for home charging of EVs. The lower the residential charging rate, the more EV users to provide energy to the commercial building during the day. This effect is clearly shown in Figures 6 and 9. For Figure 6, a home charging rate of 6 cents/kWh and for Figure 9 14 cents/kWh is assumed, and this reduces the mobile storage SOC considerably in Figure 9 compared to Figure 6.

In most cases, EVs are charged at the residential building, and only some cases show that renewable energy is transferred from the commercial building to the residential building. EVs are always used to reduce the demand charges and energy-related costs at peak or shoulder hours when PV or other DG/CHP is not fully available. Also, we have seen that all cases with increasing focus on $CO_2$ emission show increasing capacities for stationary storage, and this makes the case for considering the 2$^{nd}$ life of mobile storage, meaning to re-use EV batteries in buildings after they have decommissioned from EV usage due to tighter performance requirements in EVs.

Finally, we show the aggregated results for California. Table 9 shows the results for CEUS building stock with electric peak loads between 100 kW and 5 MW assuming a $CO_2$ minimization strategy. When assuming a full $CO_2$ minimization strategy ($w$=1), a maximum cost increase boundary needs to be imposed. Without such a cost constraint, the optimization algorithm could adopt any size of equipment, which would create very unrealistic adoption patterns as well high investment costs. For the aggregated results shown in Table 9, a cost increase constraint of 30 % was used, which is considered as realistic increase that customers can accept by 2020.

The considered commercial buildings can reduce their $CO_2$ emissions by adopting DER by roughly 37%. To achieve this reduction, roughly 15 GWh of stationary storage needs to be adopted. The utilized mobile storage is roughly 12.5 GWh, and this shows the importance to consider second life of mobile storage in form of stationary storage. The 4.55 GW of adopted PV are used to charge the stationary storage and not to charge the mobile storage (see also the diurnal electric patterns above). Finally, Table 9 also shows that CHP plays an important role in $CO_2$ minimization strategies and 3.5 GW of CHP systems will be adopted.

## 6. Conclusions

The emergence of smart grids and EVs provides opportunities for transitioning towards a more energy efficient, less costly, and greener energy system. However, deployment of these resources by commercial microgrids requires decision support that simultaneously treats investment and operations. Furthermore, there is likely to be a tradeoff between costs and $CO_2$ emissions barring more substantial policy reforms. In order to illustrate the benefits and challenges of the incorporation of EVs into a microgrid, we model the decisions of various types of California users in different geographical regions for the year 2020.

Via a MILP, we find that the use of mobile energy storage provided by EVs in commercial buildings is driven more by cost reduction objectives than by $CO_2$-reduction/efficiency improvement objectives. Under pure cost minimization, EVs are mainly used to transfer low-cost electricity from the residential building to the commercial building to avoid high demand and energy charges during expensive day hours. By contrast, with $CO_2$ minimization strategies, EVs are used to reduce the utility demand charges and energy-related costs at peak or shoulder hours when PV or CHP is not fully available. Here, the use of stationary storage is more attractive compared to EV storage, because stationary storage is available at the commercial building for 24 hours a day and readily accessible for energy management. In particular, stationary storage can shift PV supply during the day to off-peak hours, when the building would otherwise be supplied by more carbon-intensive electricity from the utility. To benefit from the stationary storage and PV $CO_2$ reduction potential, stationary storage should get a major focus in R&D funding and policy making. To be able to use mobile storage in 2$^{nd}$ life, special focus needs to be put on the process of recycling mobile storage in buildings since this creates larger $CO_2$ savings. Finally, we find that the number of connected EVs varies widely depending on the residential charging rate and possibility of arbitrage.

Although the analysis presented here attempts to model a cost- or $CO_2$-minimizing decision maker, it is limited by several assumptions and simplifications. First, it assumes a given pattern of EV arrival and departure, which is only a rough approximation of reality. Second, electricity prices are subject to uncertainty, but here they are assumed to be deterministic. In general, a stochastic model of the investment and operational decisions would better capture the risks and tradeoffs faced by a typical decision maker. Third, the model does not consider investment timing or subsequent upgrades to installed technology based on changing market conditions. Again, these features could be incorporated into a real options or stochastic programming framework. Fourth, the model assumes that in spite of the arbitrage, the energy tariffs remain unchanged. In reality, the utility is likely to respond in the long run to such forces, which would necessitate a game-theoretic model and change the incentives of the decision maker.

**Acknowledgment**
The work described in this paper was funded by the Office of Electricity Delivery and Energy Reliability, Distributed Energy Program of the U.S. Department of Energy under Contract No. DE-AC02-05CH11231 and by NEC Laboratories America Inc. We also want to thank Professor Dr. Tomás Gómez and Ilan Momber for their very valuable contributions to previous versions of DER-CAM.

**References**


CEUS, California Commercial End-Use Survey database, ITRON. Available online at: http://capabilities.itron.com/ceusweb/.

Electricity Storage Association, Morgan Hill, CA, USA (http://www.electricitystorage.org/tech/technologies_comparisons_capitalcost.htm).

EnergyPlus. Available online at: http://apps1.eere.energy.gov/buildings/energyplus/.

EPRI-DOE Handbook of Energy Storage for Transmission and Distribution Applications (2003). EPRI, Palo Alto, CA, and the U.S. Department of Energy, Washington, DC: 2003. 1001834.

Firestone, R. (2004). "Distributed Energy Resources Customer Adoption Model Technology Data," Berkeley Lab, Berkeley, CA, USA Case Study, Jan. 2004 (available at http://der.lbl.gov).

Goldstein, L., Hedman, B., Knowles, D., Friedman, S. I., Woods, R., and Schweizer, T. (2003). "Gas-Fired Distributed Energy Resource Characterizations," National Renewable Energy Resource Laboratory, Golden, CO, USA Rep. TP-620-34783, Nov. 2003.

GreenCarCongress. Available online at: http://www.greencarcongress.com/2010/10/chevy-volt-delivers-novel-two-motor-four-mode-extended-range-electric-drive-system-seamless-driver-e.html#more.

Hatziargyriou, N., Asano, H., Iravani, R., and Marnay, C. (2007). "Microgrids, An Overview of Ongoing Research, Development, and Demonstration Projects," IEEE Power & Energy Magazine, July/August 2007.

Mahone, A., Price, S., and Morrow, W. (2008). "Developing a Greenhouse Gas Tool for Buildings in California: Methodology and Use," Energy and Environmental Economics, Inc., September 10, 2008 and PLEXOS Production Simulation Dispatch Model.

Marnay, C., Venkataramanan, G., Stadler, M., Siddiqui, A., Firestone, R., Chandran, B. (2008). "Optimal Technology Selection and Operation of Microgrids in Commercial Buildings," IEEE Transactions on Power Systems, Volume 23, Issue 3, page 975-982, August 2008, ISSN 0885-8950.

Mechanical Cost Data 31st Annual Edition (2008). HVAC, Controls, 2008.

Mendes, G., Stadler, M., Marnay, C., Ioakimidis, C. (2011). "Modeling of Plug-in Electric Vehicle Interactions with a School Building using DER-CAM," Poster presented at MIT Transportation Showcase, Boston, USA, 2011.

Momber, I., Gómez, T., Venkataramanan, G., Stadler, M., Beer, S., Lai, J., Marnay, C., and Battaglia, V. (2010). "Plug-in Electric Vehicle Interactions with a Small Office Building: An Economic Analysis using DER-CAM", IEEE PES 2010 General Meeting, Power System Analysis and Computing and Economics, July 25th- 29th, Minnesota, USA, 2010, LBNL-3555E.

PG&E E-19 tariff. Available online at: http://www.PG&E.com/tariffs/tm2/pdf/ELEC_SCHEDS_E-19.pdf.

PG&E E-9 tariff. Available online at: http://www.PG&E.com/tariffs/tm2/pdf/ELEC_SCHEDS_E-9.pdf.

Schmidt, M. (2006): "Der Einsatz von Sankey-Diagrammen im Stoffstrommanagement." Beiträge der Hochschule Pforzheim. Nr. 124. University Pforzheim, Germany.

SGIP (2008). Statewide Self-Generation Incentive Program Statistics, California Center for Sustainable Energy, http://www.sdenergy.org/ContentPage.asp?ContentID=279&SectionID=276&SectionTarget=35, updated December 2008.

Siddiqui, A., Marnay, C., Edwards J., Firestone, R., Ghosh, S., and Stadler, M. (2005). "Effects of a CarbonTax on Microgrid Combined Heat and Power Adoption," Journal of Energy Engineering, American Society of Civil Engineers (ASCE), Special Issue: Quantitative Models for Energy Systems, vol. 131, Number 1, pp. 2-25, April 2005, ISSN 0733-9402.

Sioshansi, R., Denholm, P. (2009): "The Value of Plug-In Hybrid Electric Vehicles as Grid Resources," The Energy Journal, Volume: 31, Issue: 3, Pages: 1-16, ISSN: 01956574.

Stevens, J.W., Corey, G.P. (1996). "A Study of Lead-Acid Battery Efficiency Near Top-of-Charge and the Impact on PV System Design," Photovoltaic Specialists Conference, 1996, Conference Record of the Twenty Fifth IEEE, Washington, DC, USA: 1485-1488.

Stadler, M., Marnay, C., Siddiqui, A., Lai, J., Coffey, B., and Aki, H. (2008). "Effect of Heat and Electricity Storage and Reliability on Microgrid Viability: A Study of Commercial Buildings in California and New York States," Report number LBNL - 1334E, December 2008.

Stadler, M., Marnay, C., Cardoso, G., Lipman, T., Mégel, O., Ganguly, S., Siddiqui, A., and Lai, J. (2009). "The $CO_2$ Abatement Potential of California's Mid-Sized Commercial Buildings," California Energy Commission, Public Interest Energy Research Program, CEC-500-07-043, 500-99-013, LBNL-3024E, December 2009.

Stadler, M., Marnay, C., Siddiqui, A., Lai, J., and Aki, H. (2009b). "Integrated building energy systems design considering storage technologies," ECEEE 2009 Summer Study, 1–6 June 2009, La Colle sur Loup, Côte d'Azur, France, ISBN 978-91-633-4454-1 and LBNL-1752E.

Symons, P.C., Butler, P.C. (2001). "Introduction to Advanced Batteries for Emerging Applications," Sandia National Lab Report SAND2001-2022P, Sandia National Laboratory, Albuquerque, NM, USA (available at http://infoserve.sandia.gov/sand_doc/2001/012022p.pdf).

TSRC, "Plug-In Electric Vehicle Battery Second Life," Transportation Sustainability Research Center University of California (TSRC), University of California Berkeley. Available at: http://tsrc.berkeley.edu/PlugInElectricVehicleBatterySecondLife.

Wang, L., Lin, A., Chen, Y. (2010). "Potential Impact of Recharging Plug-in Hybrid Electric Vehicles on Locational Marginal Prices," Naval Research Logistics (NRL), Volume 57, Issue 8, pages 686–700, December 2010, Online ISSN: 1520-6750.

**Acronyms**

| | |
|---|---|
| CHP | combined heat and power |
| CEUS | California End-Use Survey |
| DER | distributed energy resources |
| DER-CAM | Distributed Energy Resources Customer Adoption Model |
| DG | distributed generation |
| EMS | energy management system |
| EV | electric vehicle |
| FC | fuel cells |
| HX | heat exchanger |
| ICE | internal combustion engines |
| MILP | mixed-integer linear program |
| PHEV | plug-in hybrid electric vehicles |
| PG&E | Pacific Gas & Electric |
| PV | Photovoltaics |
| SCE | Southern California Edison |
| SDG&E | San Diego and Gas Electric |
| TOU | time-of-use |

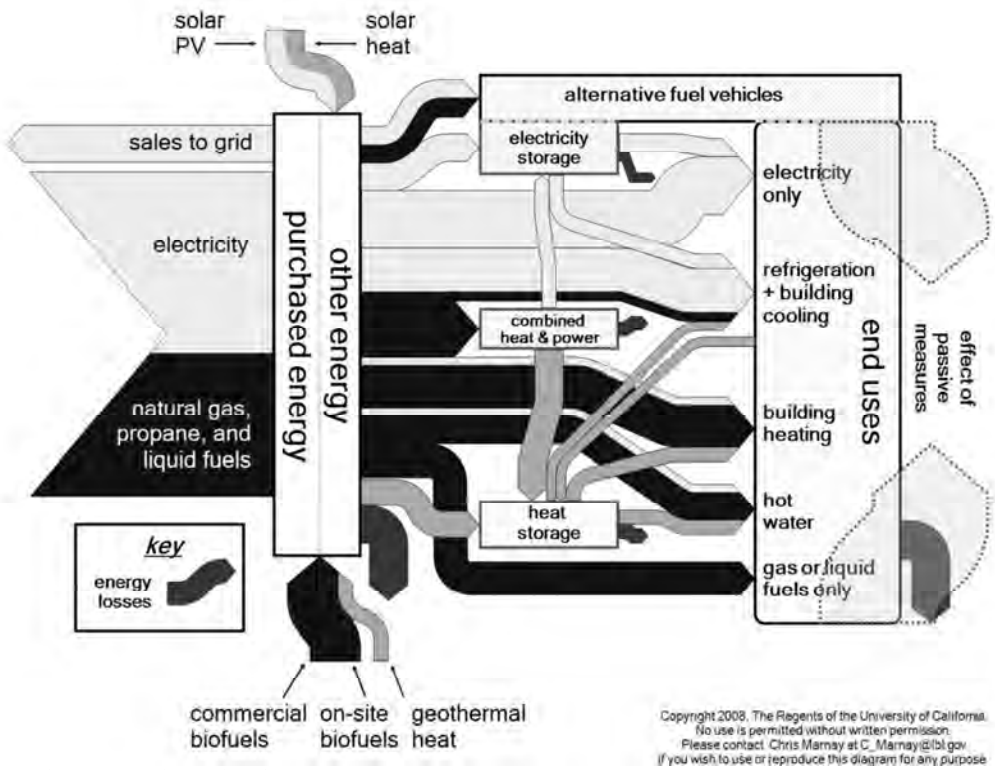


Figure 1. High level schematic of DER-CAM (Stadler et al., 2009)

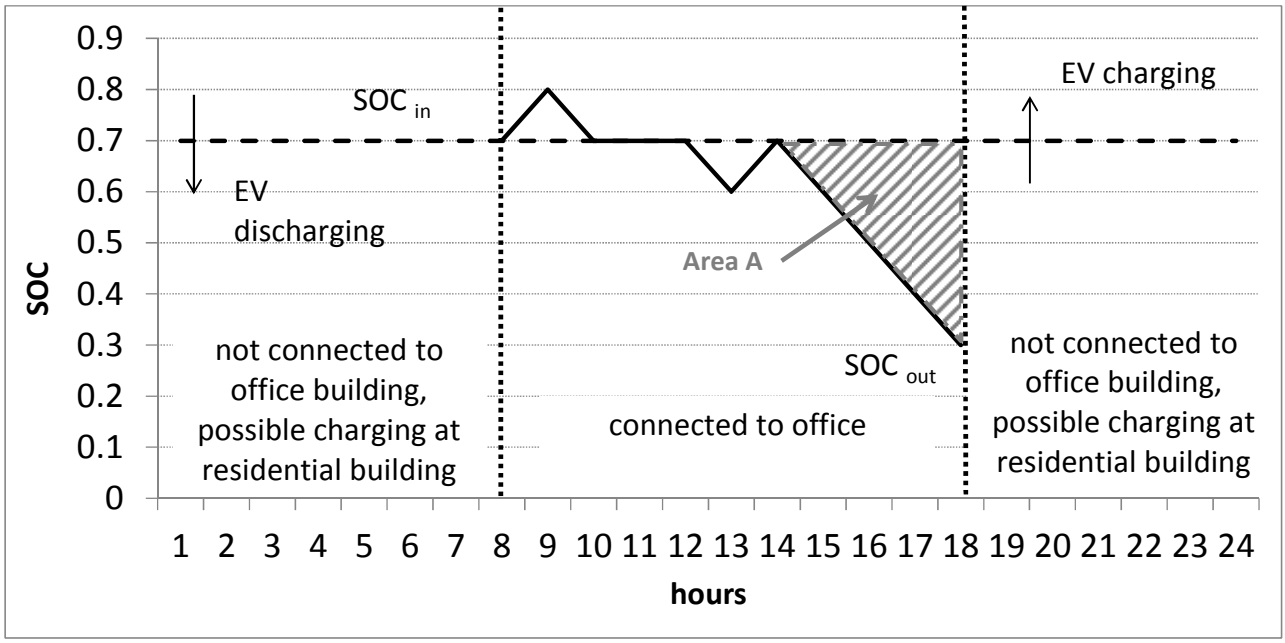


Figure 2. Hypothetical charging/discharging at a commercial (office) building, $SOC_{in}$ means mobile storage state of charge at the time when the EV connects to the building, $SOC_{out}$ means state of charge at the time when the EV disconnects from the building.

```
MINIMIZE
   Annual energy cost:
     energy purchase cost
     + amortized DER technology capital cost
     + annual O&M cost
SUBJECT TO
   Energy balance:
     - Energy purchased + energy generated exceeds demand
   Operational constraints:
     - Generators, chillers, etc. must operate within
       installed limits
     - Heat recovered is limited by generated waste heat
   Regulatory constraints:
     - Minimum efficiency requirements
     - Maximum emission limits
   Investment constraints:
     - Payback period is constrained
   Storage constraints:
     - Electricity stored is limited by battery size
     - Heat storage is limited by reservoir size
```

Figure 3. Representative MILP solved by DER-CAM

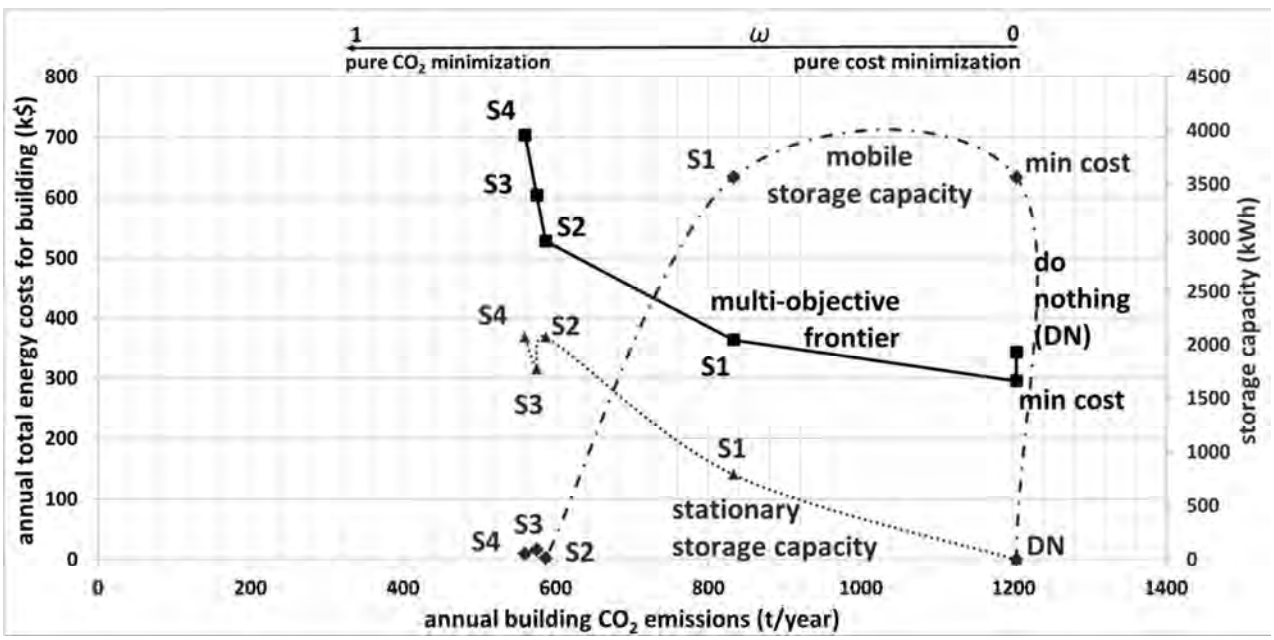


Figure 4. Results, multi-objective frontier for the large school building in the San Francisco Bay Area (PG&E service territory) and storage capacity

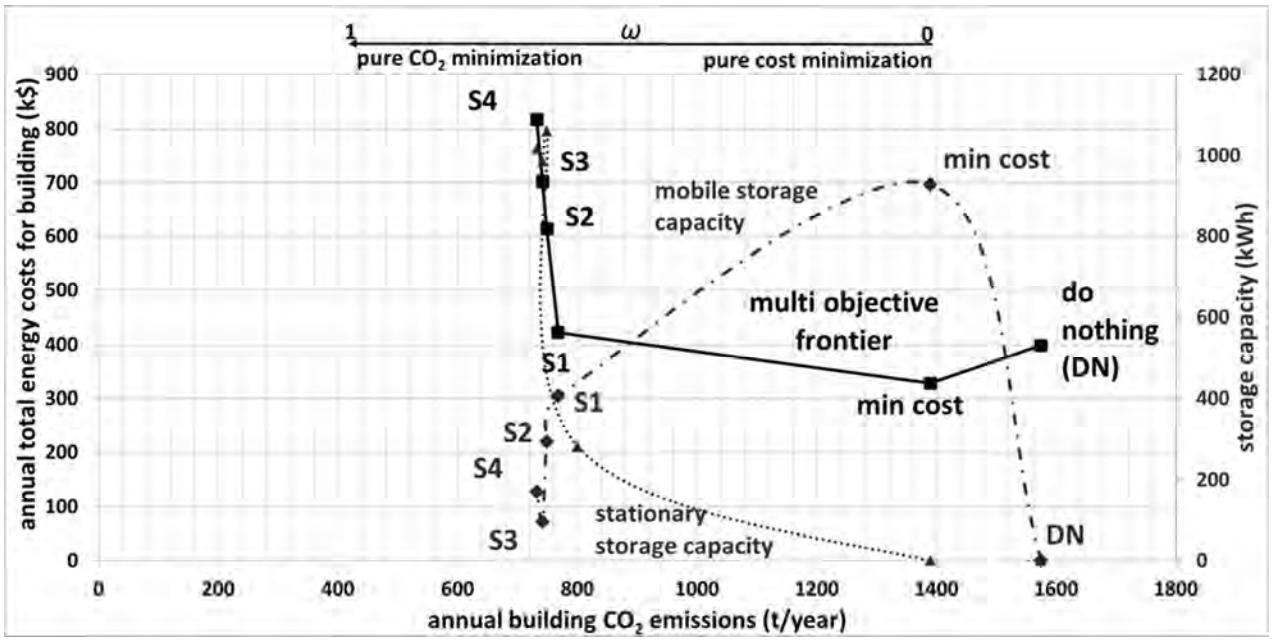


Figure 5. Results, multi-objective frontier for the healthcare facility in San Diego (SDG&E service territory) and storage capacity

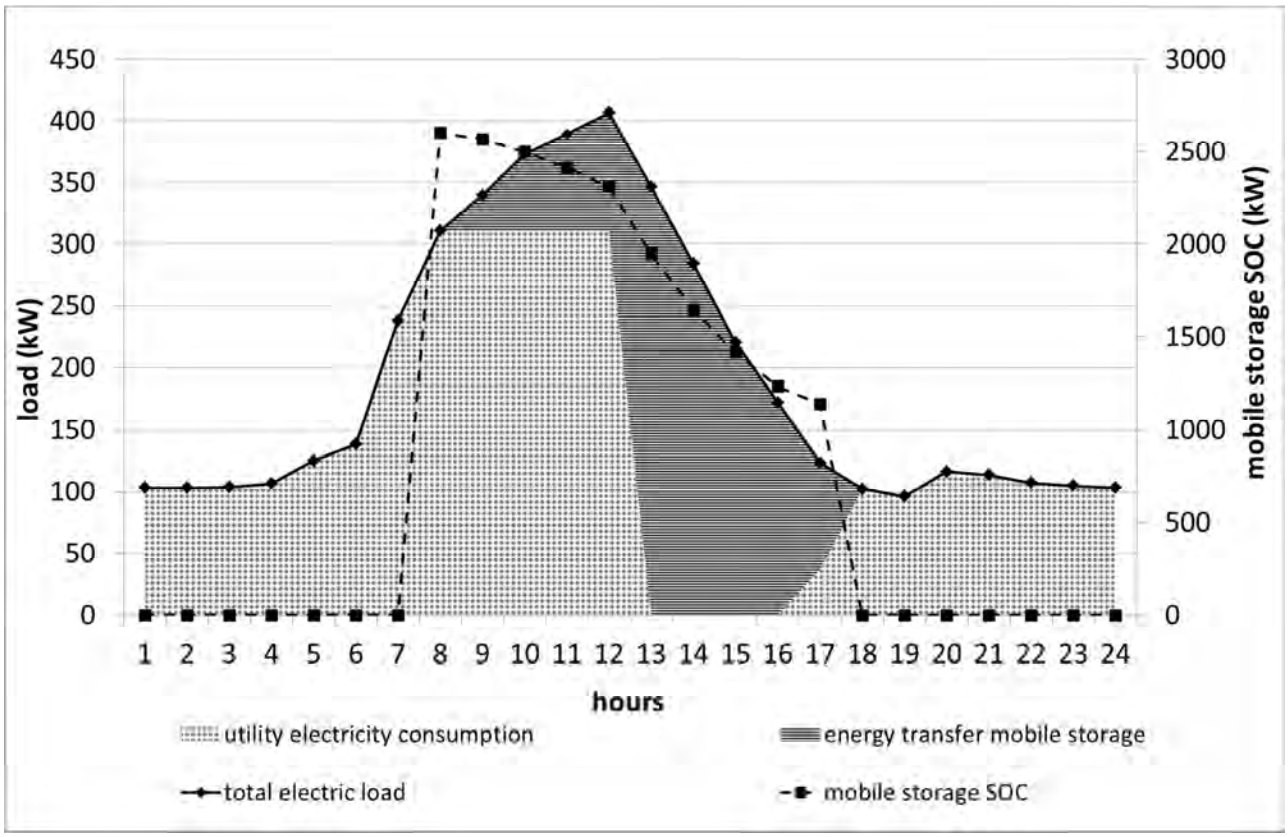


Figure 6. Diurnal electric pattern at cost-minimization on a July work day, large school in the San Francisco Bay Area (PG&E service territory)

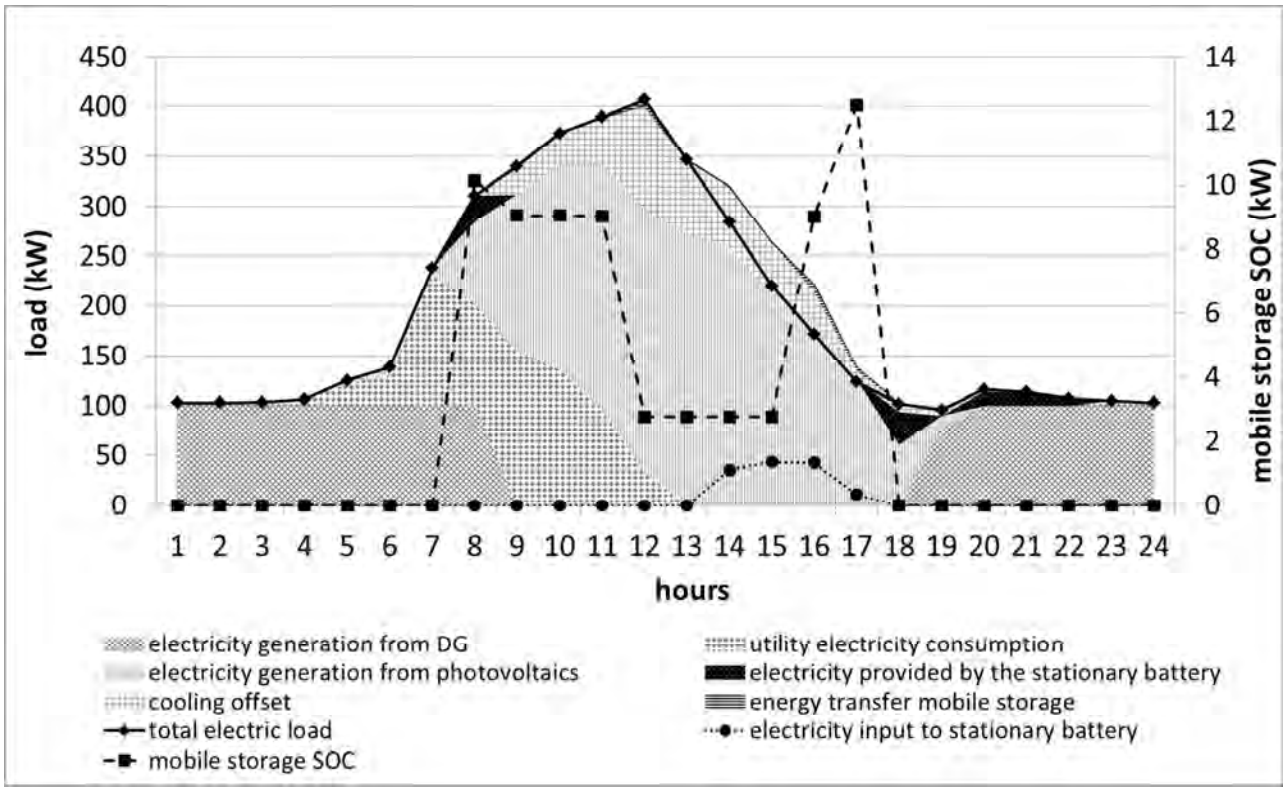


Figure 7. Diurnal electric pattern for point S2 on a July work day, large school in the San Francisco Bay Area (PG&E service territory)

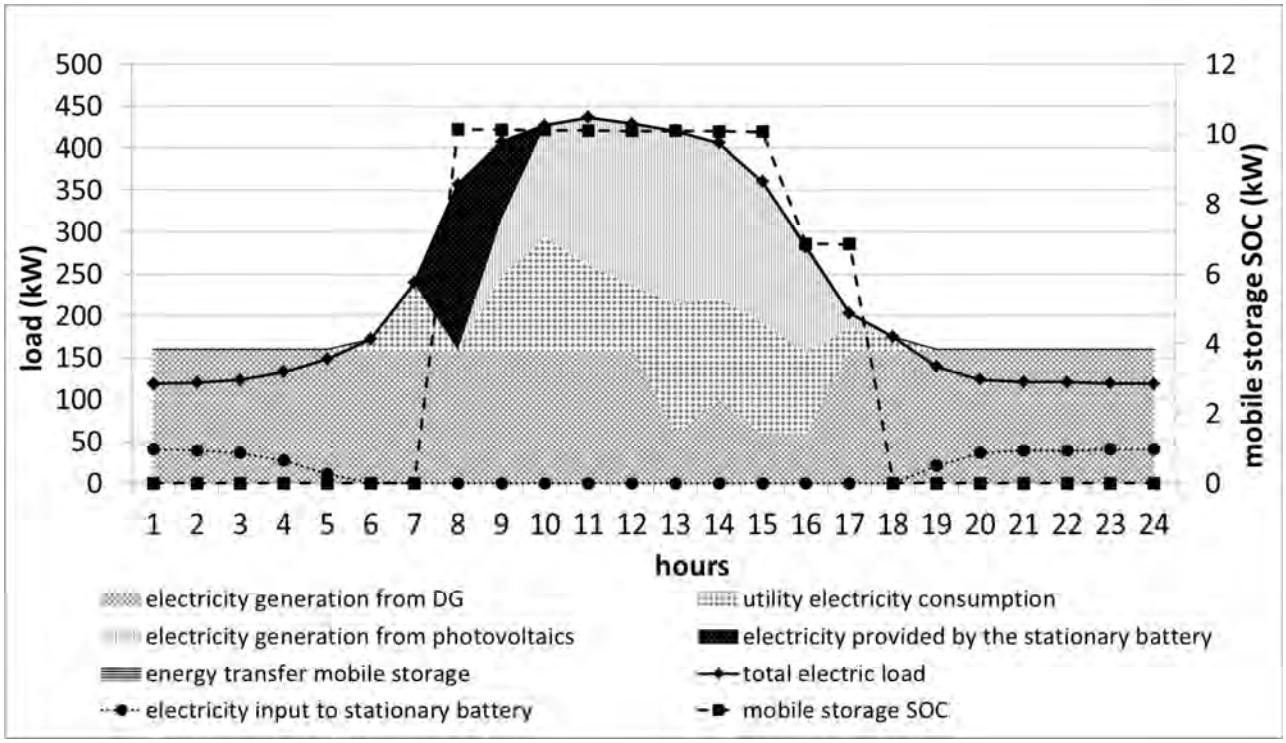


Figure 8. Diurnal electric pattern for point S2 on a January work day, large school in the San Francisco Bay Area (PG&E service territory)

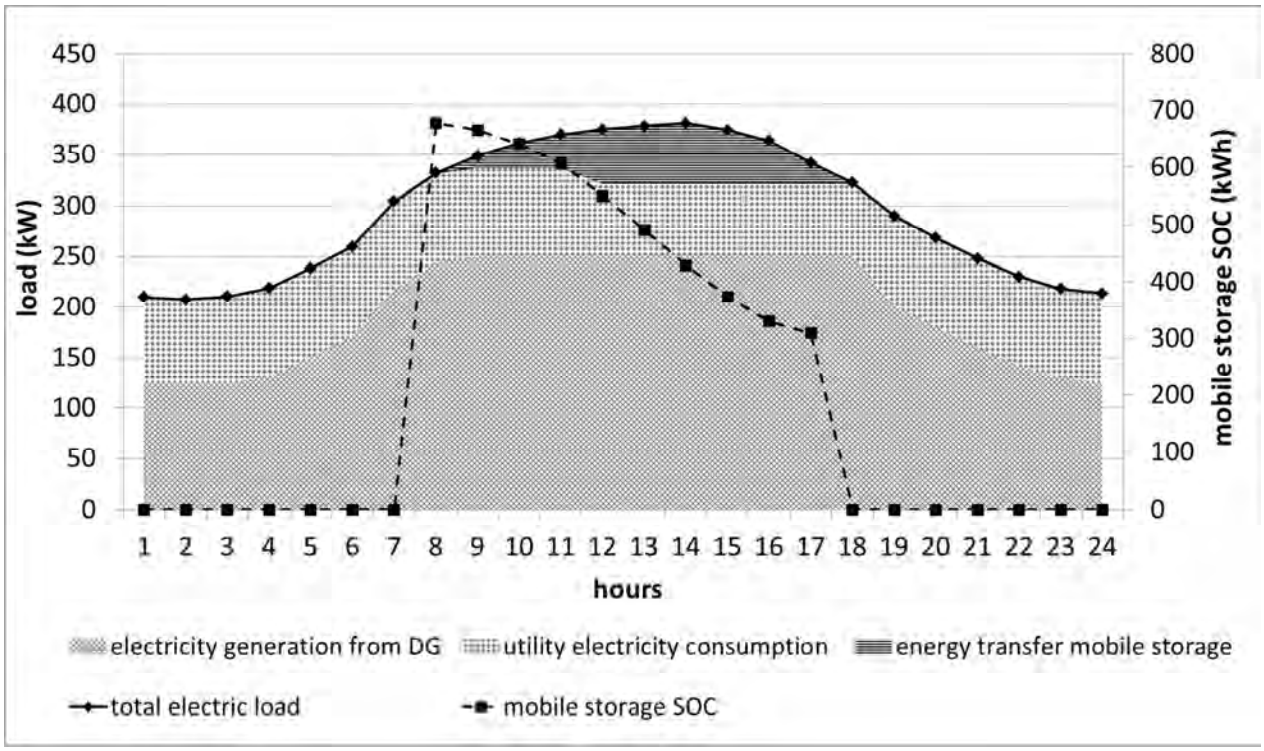


Figure 9. Diurnal electric pattern on a July work day for minimal costs for the healthcare facility in San Diego (SDG&E service territory)

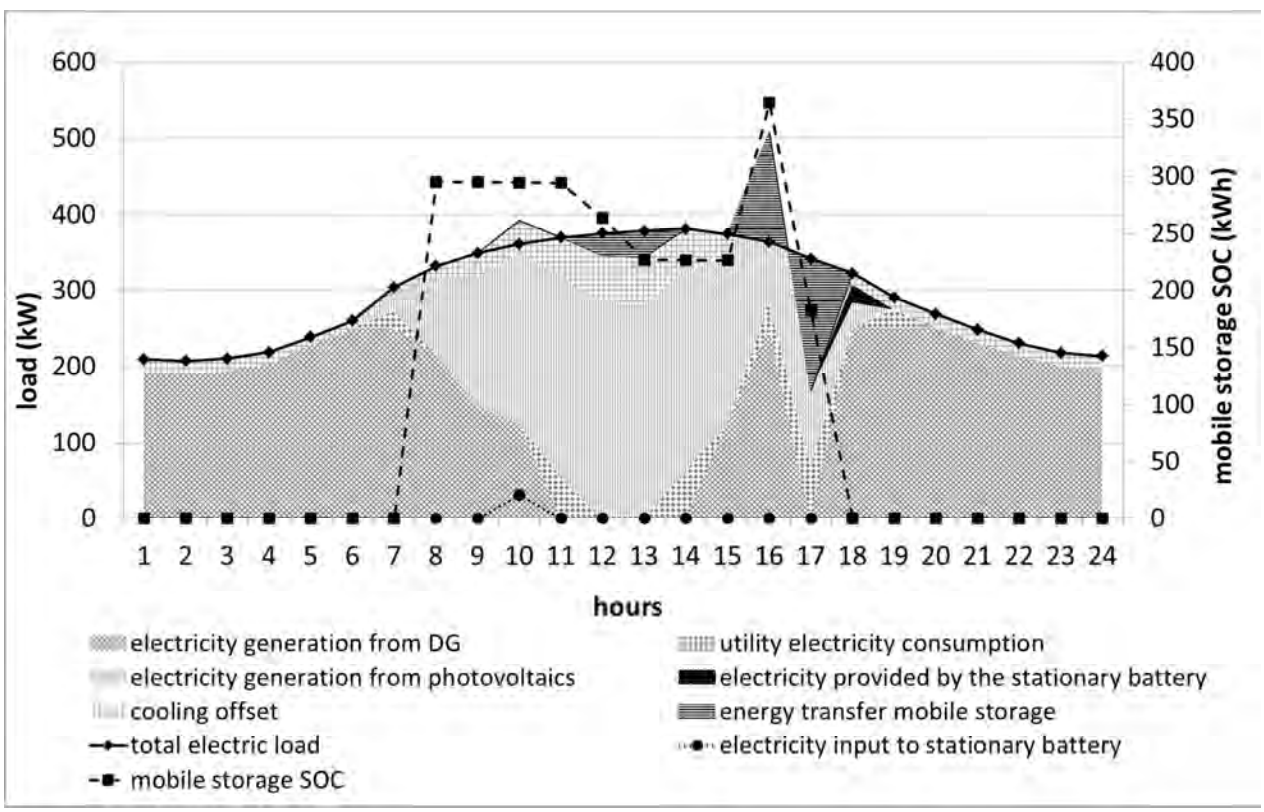


Figure 10. Diurnal electric pattern for point S1 on a July work day for the healthcare facility in San Diego (SDG&E service territory)

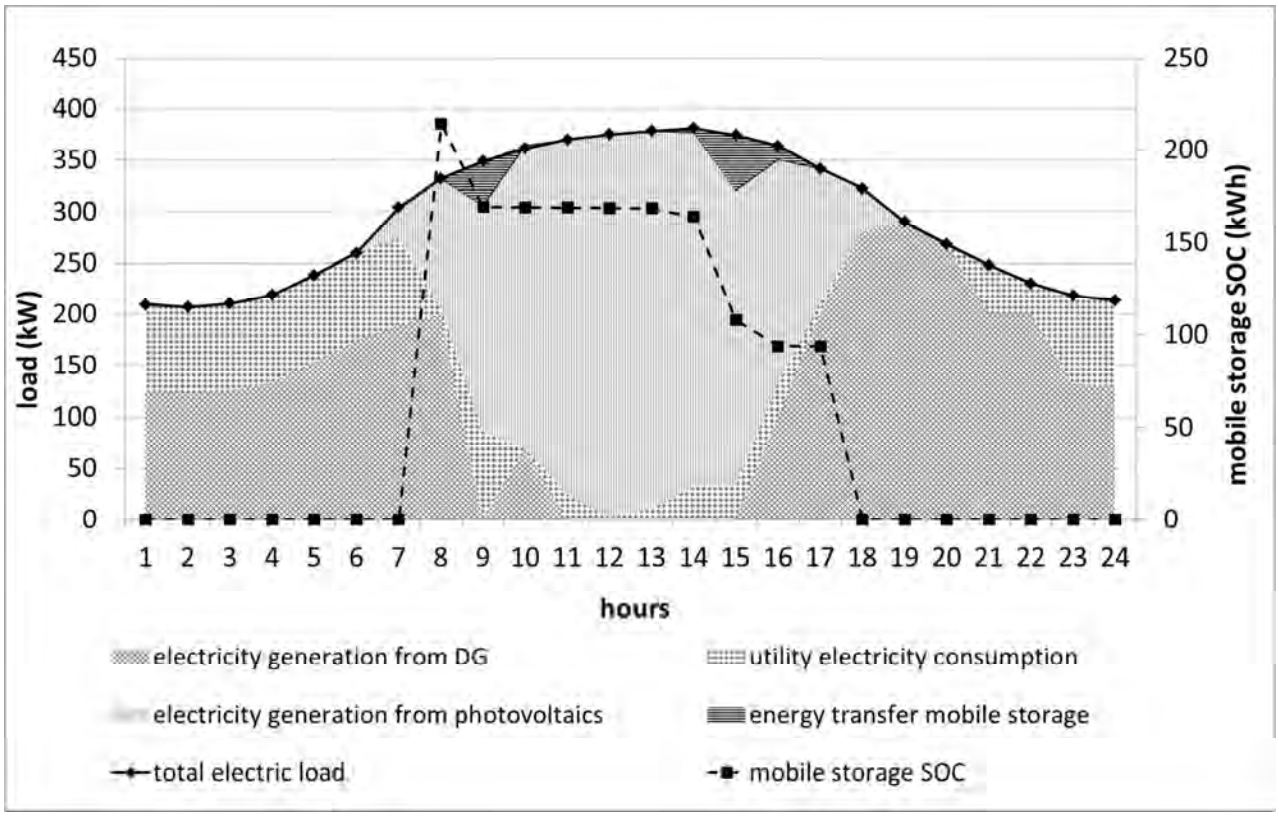


Figure 11. Diurnal electric pattern for point S2 on a July work day for the healthcare facility in San Diego (SDG&E service territory)

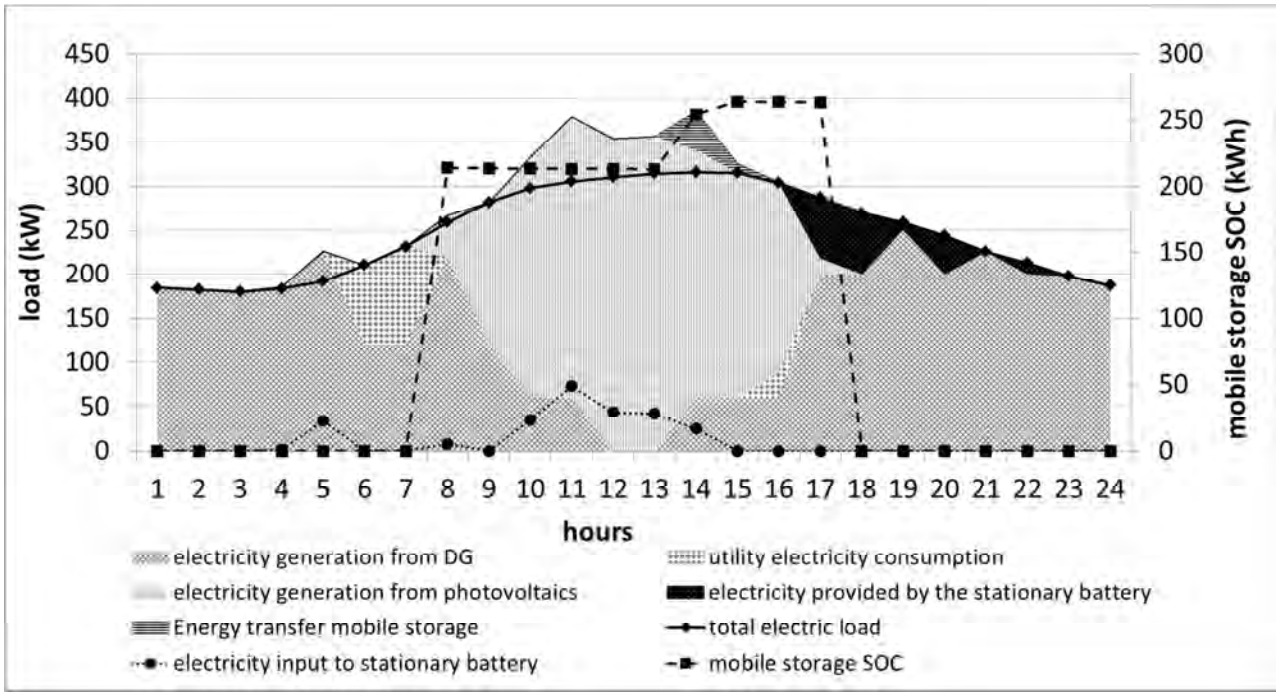


Figure 12. Diurnal electric pattern for point S2 on a January work day for the healthcare facility in San Diego (SDG&E service territory)

Table1. Available discrete technologies[16] in 2020 (Goldstein et al., 2003), (Firestone, 2004), (SGIP, 2008)

| | | ICE | | FC | |
|---|---|---|---|---|---|
| | | S | M | S | M |
| capacity (kW) | | 60 | 250 | 100 | 250 |
| installed cost ($/kW) | | 2721 | 1482 | 2382 | 1909 |
| | w/HX | 3580 | 2180 | 2770 | 2220 |
| maintenance cost ($/kWh) | | 0.02 | 0.01 | 0.03 | 0.03 |
| electrical efficiency[17] (%) | | 29 | 30 | 36 | 36 |
| heat to power ratio (if w/HX) | | 1.73 | 1.48 | 1.00 | 1.00 |
| lifetime (years) | | 20 | 20 | 10 | 10 |

Table 2. Available continuous DER technologies in 2020 (Firestone, 2004), (SGIP, 2008), (EPRI-DOE, 2003), (Mechanical Cost Data 31st Annual Edition, 2008), (Stevens and Corey, 1996), (Symons and Butler, 2001), (Electricity Storage Association)

| | ES | TS | AC | ST | PV |
|---|---|---|---|---|---|
| capital cost ($) | 295 | 10000 | 93911 | 0 | 3851 |
| variable cost ($/kW or $/kWh when referring to storage) | 193 | 100 | 685 | 500 | 3237 |
| maintenance cost ($/kWh) | 0 | 0 | 1.88 | 0.50 | 0.25 |
| lifetime (years) | 5 | 17 | 20 | 15 | 20 |

*ES – stationary electrical storage, TS – thermal storage, AC - absorption cooling, ST-solar thermal, PV-Photovoltaics*

Table 3. Assumed stationary energy storage parameters (Stevens and Corey, 1996), (Symons and Butler, 2001)

| | ES | TS |
|---|---|---|
| charging efficiency | 0.9 | 0.9 |
| discharging efficiency | 0.9 | 0.9 |
| decay | 0.001 | 0.01 |
| maximum charge rate | 0.1 | 0.25 |
| maximum discharge rate | 0.25 | 0.25 |
| minimum state of charge | 0.3 | 0 |

*Notes: all parameters are dimensionless; ES – stationary electrical storage, TS – thermal storage;*

Table 4. EV battery specifications

| | |
|---|---|
| charging efficiency | 0.95 |
| discharging efficiency | 0.95 |
| battery hourly decay (related to stored electricity) | 0.001 |
| capacity | 16 kWh |

Table 5. Principle EV connection periods for different building types[18]

| building type | building connection period | EV owners |
|---|---|---|
| Hotel | 19h-8h | guests |
| Office | 9h-18h | employees |
| School/College | 8h-18h | employees |
| Retail | 9h-18h | employees/customers |
| Restaurant | 18h-21h | employees/customers |
| Warehouse | 8h-18h | employees |
| Grocery | 9h-18h | employees/customers |
| Healthcare | 8h-18h | employees |

[16] DER-CAM distinguishes between discrete and continues technologies. Discrete technologies can only be picked in discrete sizes and continues ones in any size. The usage of continues technologies increases the optimization performance and reduces the run time. Also gas turbines and micro turbines are available, but they were never selected in the optimization, and therefore, not shown here.
[17] Higher heating Value.
[18] For clarity, some of the formal building types were aggregated (i.e large and small offices).

Table 6. Area constraints for PV, solar thermal, and EVs (CEUS and own calculations)

| building type | area constraint $A$ ($m^2$) |
|---|---|
| Hotel | 3600 |
| Small Office | 175 |
| Warehouse | 1390 |
| School | 3340 |
| Retail | 800 |
| Restaurant | 300 |
| Refrigerated Warehouse | 5560 |
| Large Office | 16200 |
| Healthcare | 3260 |
| Grocery | 540 |
| College | 5600 |

Table 7. Detailed optimization results for large school building

| | do-nothing (DN) | min cost | S1 | S2 | S3 | S4 |
|---|---|---|---|---|---|---|
| equipment | | | | | | |
| inernal combustion CHP (kW) | | | 250 | 60 | 120 | 420 |
| fuell cell CHP (kW) | | | | 100 | 350 | 350 |
| abs. Chiller (kW in terms of electricity) | | | | 106 | 142 | 113 |
| solar thermal collector (kW) | | 91 | 308 | 779 | 961 | 779 |
| PV (kW) | | | 193 | 352 | 315 | 352 |
| stationary electric storage (kWh) | | | 790 | 2068 | 1769 | 2068 |
| mobile electric storage (kWh) | | 3563 | 3563 | 14 | 91 | 53 |
| thermal storage (kWh) | | | 767 | 2932 | 3063 | 2932 |
| annual building costs (k$) | | | | | | |
| electricity | 269.24 | 212.38 | 90.21 | 65.98 | 36.07 | 40.81 |
| NG | 73.74 | 67.88 | 94.36 | 94.33 | 115.90 | 109.77 |
| onsite DG technologies (amortized costs) | | 15.02 | 179.02 | 367.91 | 451.71 | 552.57 |
| total | 342.97 | 295.28 | 363.58 | 528.22 | 603.68 | 703.15 |
| % savings compared to do-nothing | | 13.90 | -6.01 | -54.01 | -76.02 | -105.02 |
| annual utility consumption (GWh) | | | | | | |
| electricity | 1.74 | 1.39 | 0.58 | 0.36 | 0.15 | 0.17 |
| NG | 1.74 | 1.60 | 2.23 | 2.24 | 2.76 | 2.62 |
| annual building carbon emissions (t/a) | | | | | | |
| emissions | 1203.92 | 1203.79 | 833.18 | 586.99 | 575.33 | 559.94 |
| % savings compared to do-nothing | | 0.01 | 30.79 | 51.24 | 52.21 | 53.49 |

Table 8. Detailed optimization results for healthcare facility

| | do-nothing (DN) | min cost | S1 | S2 | S3 | S4 |
|---|---|---|---|---|---|---|
| equipment | | | | | | |
| inernal combustion CHP (kW) | | 250 | | 180 | 180 | 180 |
| fuell cell CHP (kW) | | | 250 | 550 | 300 | 500 |
| abs. Chiller (kW in terms of electricity) | | | 67 | | 64 | 43 |
| solar thermal collector (kW) | | | 792 | 280 | 323 | 305 |
| PV (kW) | | | 337 | 441 | 433 | 436 |
| stationary electric storage (kWh) | | | 281 | 1061 | 986 | 1017 |
| mobile electric storage (kWh) | | 929 | 405 | 293 | 95 | 170 |
| thermal storage (kWh) | | | 0 | 440 | 15582 | 23353 |
| annual building costs (k$) | | | | | | |
| electricity | 336.07 | 83.70 | 19.37 | 33.48 | 42.41 | 39.97 |
| NG | 62.74 | 173.57 | 118.77 | 106.00 | 105.90 | 110.37 |
| onsite DG technologies (amortized costs) | | 70.70 | 284.62 | 474.72 | 553.64 | 667.26 |
| total | 398.81 | 327.97 | 422.76 | 614.20 | 701.94 | 817.60 |
| % savings compared to do-nothing | | 17.76 | -6.01 | -54.01 | -76.01 | -105.01 |
| annual utility consumption (GWh) | | | | | | |
| electricity | 2.33 | 0.58 | 0.06 | 0.19 | 0.18 | 0.10 |
| NG | 2.13 | 5.91 | 4.04 | 3.61 | 3.60 | 3.76 |
| annual building carbon emissions (t/a) | | | | | | |
| emissions | 1574.39 | 1389.53 | 767.38 | 748.68 | 741.65 | 732.06 |
| % savings compared to do- nothing | | 11.74 | 51.26 | 52.45 | 52.89 | 53.50 |

Table 9. Aggregated results for $CO_2$ minimization

| | | |
|---|---|---|
| energy cost savings buildings compared to do-nothing* | [%] | -30.00 |
| $CO_2$ emission reduction of buildings compared to do-nothing | [%] | 37.13 |
| number of cars energy management system (EMS) would like to utilize | [million cars] | 0.78 |
| mobile storage capacity | [GWh] | 12.45 |
| PV in buildings | [GW] | 4.55 |
| stationary storage | [GWh] | 14.71 |
| combined heat and power (CHP) and other distributen generation (DG) | [GW] | 3.50 |

*) the average max cost increase due to $CO_2$ minimization was set to 30% and is constrained within DER-CAM